

## Test box, GCU overvoltage (AM-02-00) - Support equipment and tools data

### Table of contents

#### References

- |   |              |
|---|--------------|
| 1 | Application  |
| 2 | Dimensions   |
| 3 | Mass (total) |
| 4 | Part List    |

### List of tables

- |   |                           |
|---|---------------------------|
| 1 | References                |
| 2 | Test box, GCU overvoltage |

### List of figures

- |   |                           |
|---|---------------------------|
| 1 | Test box, GCU overvoltage |
|---|---------------------------|

## References

Table 1 References

Data Module	Title
No References	

## Description

### 1 Application

This tool is necessary to do the scheduled maintenance activities on the two generator control unit using the applicable GCU test connector.

It must be used on aircraft, at line maintenance level to satisfy the scheduled maintenance requirements related to the operational check of GCU over-voltage protection function.

### 2 Dimensions

- 
- Length:
  - Height:
  - Width:
- 

### 3 Mass (total)


- 
- Mass:
-

## 4 Part List

Refer to Figure 1 .

*Table 2 Test box, GCU overvoltage*

Fig ref	Part Number	Nomenclature	Units per assembly
1-00	3G2405G00131	Test box, GCU overvoltage	1

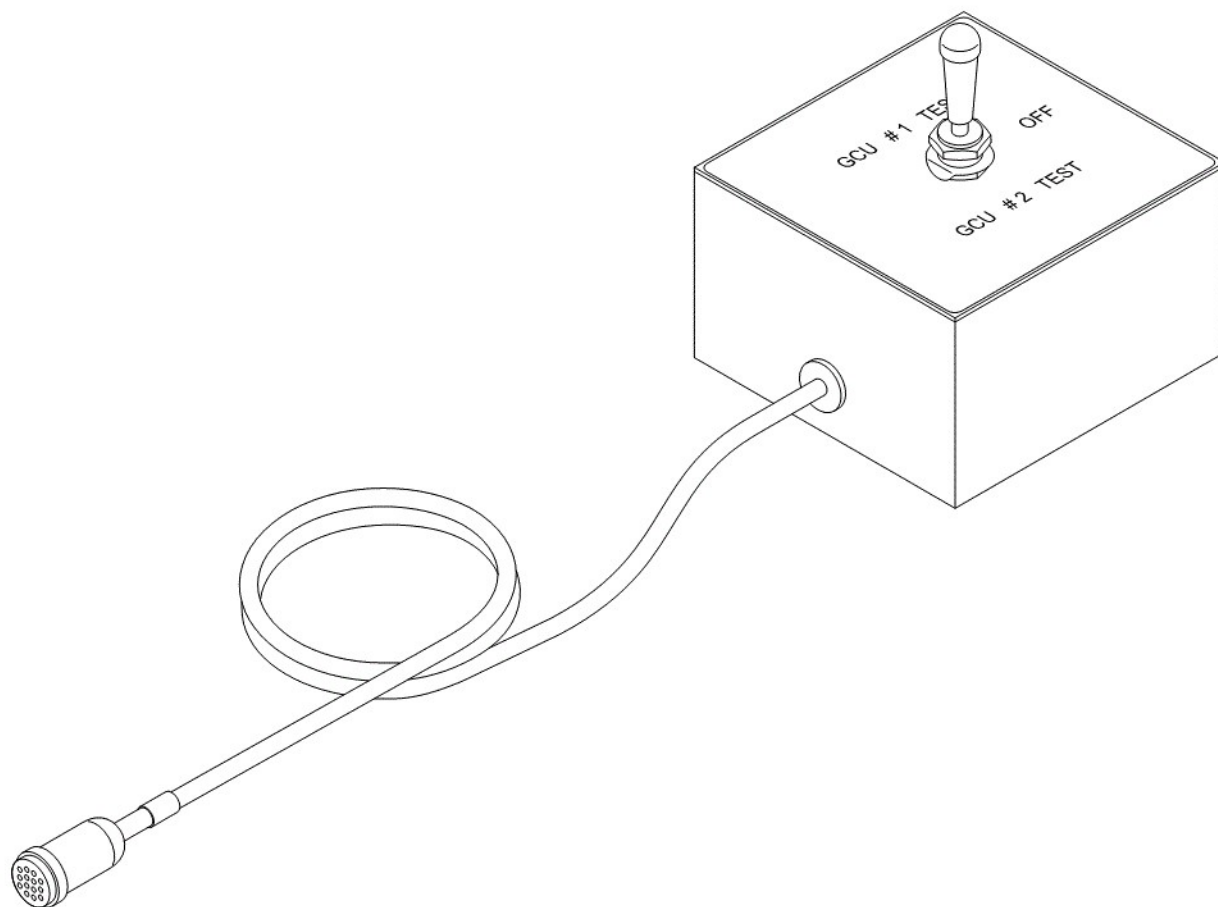

ICN-39-A-AM0200-A-00003-00068-A-001-01

*Figure 1 Test box, GCU overvoltage*